


FLOW TEST SUMMARY

1007

Project Number:
 Project Name: WALGREENS REMODEL-HWY 9 AND 204TH ST
 Date of Test: February 4, 2014 Time: 11:00 AM
 Conducted / Witnessed by: BURNS FIRE PROTECTION SYSTEMS/CITY OF ARLINGTON

Hydrant Description: HYDRANT IN PARKING ARCHITECTURAL CABINETS PARKING LOT

Flow at Hyd No	Static at Hyd No	Static PSIG	Residual PSIG	Adjusted flow in GPM	Pitot Guage	Outlet Coefficient	Adjusted flow in GPM at 20 PSI
Test No. 1 - One 2-1/2" Outlet Flowing							
1	3	90 PSI	80 PSI	839 GPM	25	0.9	2400
Test No. 2 - Two 2-1/2" Outlets Flowing							
1	3	0 PSI	0 PSI	0 GPM	0	0	0
2	3	0 PSI	0 PSI	0 GPM	0	0	0
Combined		0 PSI	0 PSI	0 GPM	Total Flow		0

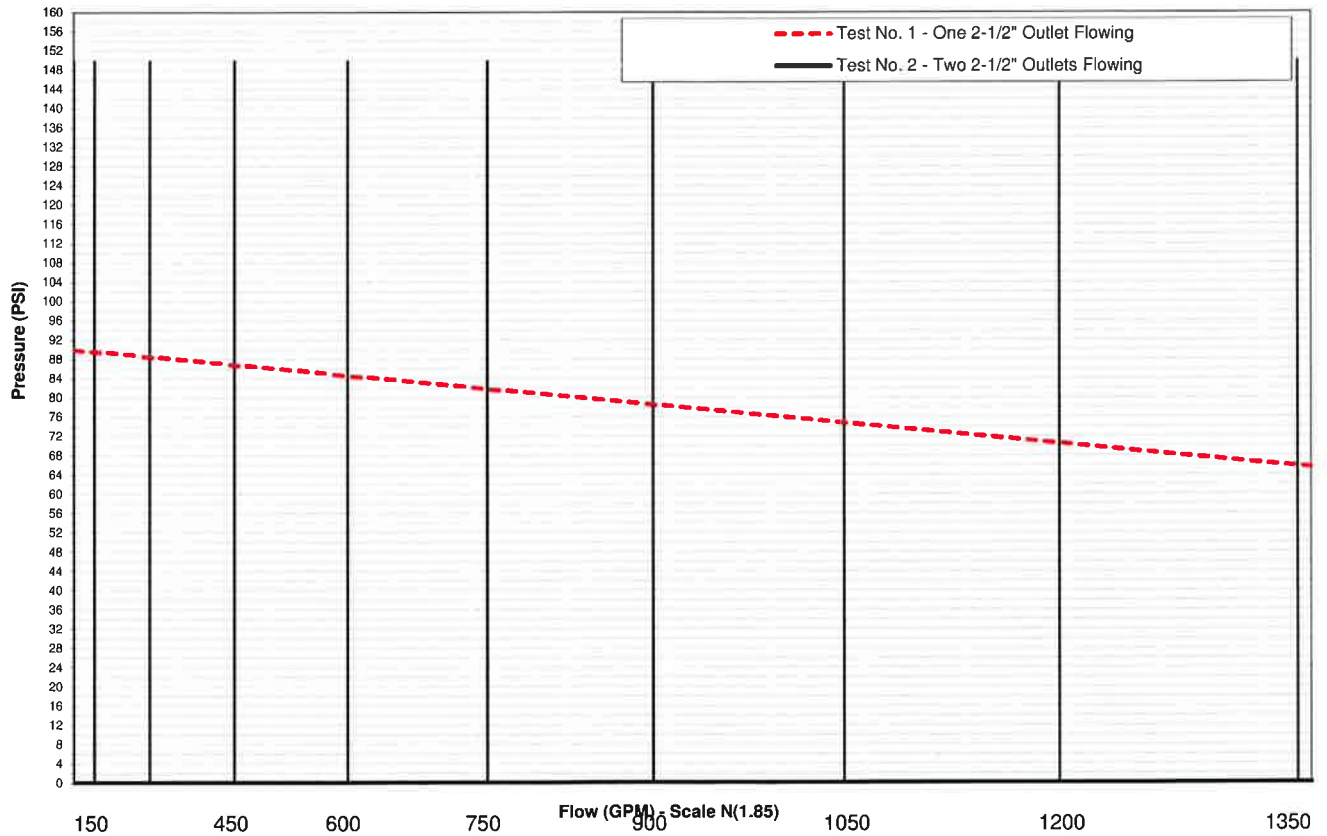

FLOW TEST SUMMARY

FLOW GRAPH NON-LOGRITHMIC SCALE

